



**PYLONTECH**



# **Lithium-Ion Phosphate Battery**

## **US2000 Plus Product Manual**



# Pylon Technologies Co., Ltd.

No. 73, Lane 887, Zu Chongzhi Road, Zhangjiang Hi-Tech Park  
Pudong, Shanghai 201203, China

This manual introduces US2000 Plus from Pylontech. Please read this manual before you install the battery and follow the instruction carefully during the installation process.

Any confusion, please contact Pylontech immediately for advice and clarification.

## Contents

<b>1. SAFETY PRECAUTIONS.....</b>	<b>3</b>
1.1 Before using.....	3
1.2 In Using.....	4
<b>2. INTRODUCTION.....</b>	<b>5</b>
2.1 Features.....	5
2.2 Specifications.....	6
2.3 Equipment Interface Instruction.....	7
US2000 Plus Product Front Interface .....	7
Definition of RJ45 Port Pin.....	8
Definition of RJ11 Port Pin.....	8
LED Indicators Instructions.....	9
<b>3. SAFE HANDLING OF LITHIUM BATTERIES GUIDE.....</b>	<b>10</b>
3.1 Schematic Diagram of Solution.....	10
3.2 Explanation of Symbol .....	10
3.3 Tools.....	11
3.4 Safety Gear.....	11
3.5 Accessories.....	11
<b>4. INSTALLATION.....</b>	<b>12</b>
4.1 Package Items.....	12
Unpacking and check the Packing List.....	12
4.2 Installation Location.....	13
Installation.....	13
<b>5. TROUBLE SHOOTING STEPS.....</b>	<b>20</b>
5.1 Problem determination based on:.....	20
5.2 Preliminary determination steps:.....	20
5.3 The battery cannot be charged or discharged .....	21
<b>6. EMERGENCY SITUATIONS.....</b>	<b>21</b>

## 1. Safety Precautions



### Reminding

- 1) It is very important and necessary to read the user manual carefully (in the accessories) before installing or using battery. Failure to do so or to follow any of the instructions or warnings in this document can result in electrical shock, serious injury, or death, or can damage battery, potentially rendering it inoperable.
- 2) If the battery is stored for long time , it is required to charge them every six months, and the SOC should be no less than 90%;
- 3) Battery needs to be recharged within 12 hours, after fully discharged;
- 4) Do not expose cable outside;
- 5) All the battery terminals must be disconnected for maintenance;
- 6) Please contact the supplier within 24 hours if there is something abnormal.
- 7) Do not use cleaning solvents to clean battery;
- 8) Do not expose battery to flammable or harsh chemicals or vapors;
- 9) Do not paint any part of battery, include any internal or external components;
- 10) Do not connect battery with PV solar wiring directly;
- 11) The warranty claims are excluded for direct or indirect damage due to items above.
- 12) Any foreign object is prohibited to insert into any part of battery.



### Warning

#### 1.1 Before Connecting

- 1) After unpacking, please check product and packing list first, if product is damaged or lack of parts, please contact with the local retailer;
  - 2) Before installation, be sure to cut off the grid power and make sure the battery is in the turned-off mode;
  - 3) Wiring must be correct, do not mistake the positive and negative cables, and ensure no short circuit with the external device;
  - 4) It is prohibited to connect the battery and AC power directly;
  - 5) The embedded BMS in the battery is designed for 48VDC, please DO NOT connect battery in series;
-



# Pylon Technologies Co., Ltd.

No. 73, Lane 887, Zu Chongzhi Road, Zhangjiang Hi-Tech Park  
Pudong, Shanghai 201203, China

---

- 6) Battery system must be well grounded and the resistance must be less than  $1\Omega$ ;
- 7) Please ensured the electrical parameters of battery system are compatible to related equipment;
- 8) Keep the battery away from water and fire.

## 1.2 In Using

- 1) If the battery system needs to be moved or repaired, the power must be cut off and the battery is completely shutdown;
- 2) It is prohibited to connect the battery with different type of battery.
- 3) It is prohibited to put the batteries working with faulty or incompatible inverter;
- 4) It is prohibited to disassemble the battery (QC tab removed or damaged);
- 5) In case of fire, only dry powder fire extinguisher can be used, liquid fire extinguishers are prohibited;
- 6) Please do not open, repair or disassemble the battery except staffs from Pylontech or authorized by Pylontech. We do not undertake any consequences or related responsibility which because of violation of safety operation or violating of design, production and equipment safety standards.

## 2. Introduction

US2000 Plus lithium iron phosphate battery is one of new energy storage products developed and produced by Pylontech, it can be used to support reliable power for various types of equipments and systems. US2000 Plus is especially suitable for application scene of high power, limited installation space, restricted load-bearing and long cycle life

US2000 Plus has built-in BMS battery management system, which can manage and monitor cells information including voltage, current and temperature. What's more, BMS can balance cells charging and discharging to extend cycle life.

Multiple batteries can be connected in parallel to expand capacity and power in parallel for larger capacity and longer power supporting duration requirements.

### 2.1 Features

- The whole module is non-toxic, non-polluting and environmentally friendly;
- Cathode material is made from LiFePO<sub>4</sub> with safety performance and long cycle life;
- Battery management system (BMS) has protection functions including over-discharge, over-charge, over-current and high/low temperature;
- The system can automatically manage charge and discharge state and balance current and voltage of each cell;
- Flexible configuration, multiple battery modules can be in parallel for expanding capacity and power
- Adopted self-cooling mode rapidly reduced system entire noise;  
The module has less self-discharge, up to 6 months without charging on shelf;  
no memory effect, excellent performance of shallow charge and discharge;
- Working temperature range is from -10°C to 50°C, (Charging 0~50°C; discharging -10~50°C) with excellent discharge performance and cycle life;
- Small size and light weight, standard of 19-inch embedded designed module is comfortable for installation and maintenance;




# Pylon Technologies Co., Ltd.

**PYLONTECH**

No. 73, Lane 887, Zu Chongzhi Road, Zhangjiang Hi-Tech Park  
Pudong, Shanghai 201203, China

## 2.2 Specifications

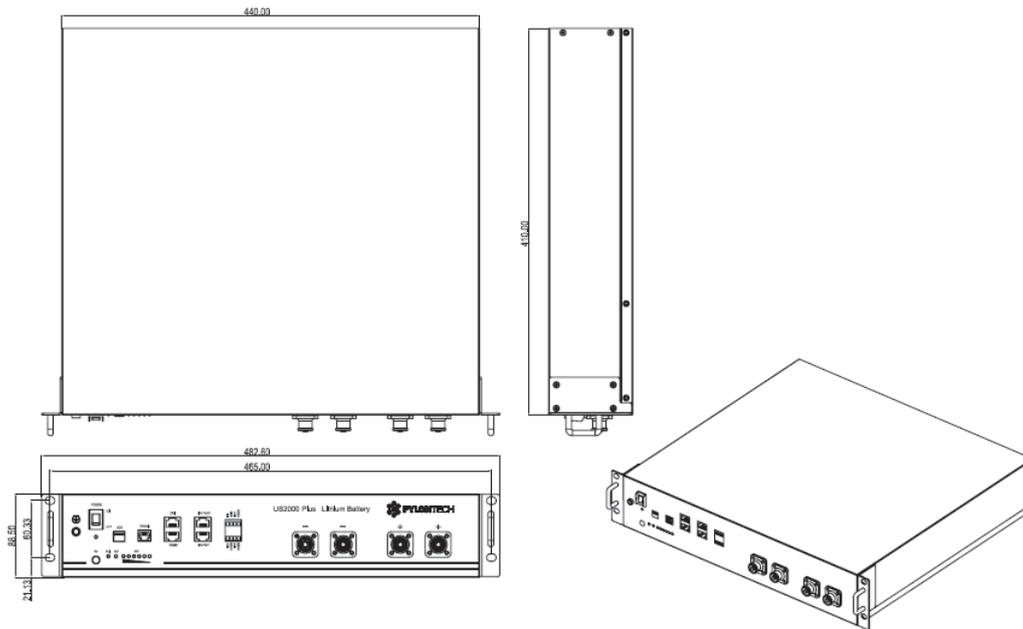


Basic Parameters	US2000 Plus
Nominal Voltage (V)	48
Nominal Capacity (kWh)	2400
Usable Capacity (kWh)	2200
Dimension (mm)	440*410*88.5
Weight (Kg)	24
Discharge Voltage (V)	45 ~ 54
Charge Voltage (V)	52.5 ~ 54
Recommend Charge/Discharge Current (A)	25
Max. Charge/Discharge Current (A)	50
Peak Charge/Discharge Current (A)	100 @ 15s
Communication	RS232, RS485, CAN
Working Temperature	0°C~50°C Charge
	-10°C~50°C Discharge
Shelf Temperature	-20°C~60°C
Certification	TÜV/ CE / UN38.3
Design life	10+ Years (25°C/77°F)
Cycle Life	>4,500 25°C

## 2.3 Equipment Interface Instruction

This section details the front and back panel of the interface functions.

### US2000 Plus Product Front Interface

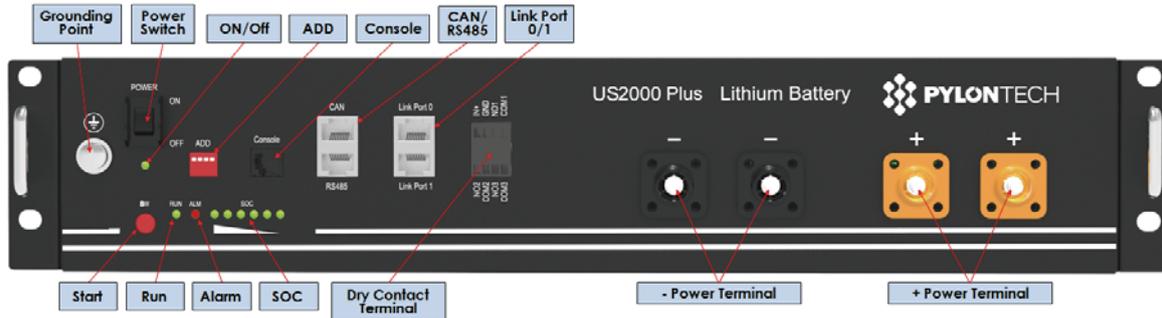

#### Power Switch

Power Switch: to turn ON/OFF the whole battery BMS standby, no power output.

#### ON/OFF

ON/OFF light: green LED lighting to show the Power Switch is ON, and the BMS has electricity (No power).

#### RUN

RUN light: green LED flashing to show the battery is running.

#### Alarm

Alarm light: red LED flashing to show the battery has alarm, and lighting to show the battery is under protection.

#### SOC

SOC light: green LEDs to show the battery's current capacity.

#### Start

Start Button: press more than 0.5s to start the battery module, Power output ready.

#### ADD Switch (5)

ADD Switch: 4 ADD switches, to definite different baud rate. Nether position is OFF, means "0". Upper position is ON, means "1". "0000" setup the baud rate 115200, and "1000" setup the baud rate 9600.



#### Console

Console Communication Terminal: (RJ11 port) follow RS232 protocol, for manufacturer or professional engineer to debug or service.

## CAN

CAN Communication Terminal: (RJ45 port) follow CAN protocol, for output batteries information.

## RS485

R485 Communication Terminal: (RJ45 port) follow RS485 protocol, for output batteries information.

## Link Port 0, 1

Link Port 0, 1 Communication Terminal: (RJ45 port) follow RS485 protocol, for communication between multiple parallel batteries.


### Definition of RJ45 Port Pin

No.	RS485 Pin	CAN Pin
1	RS485B	--
2	RS485A	GND
3	GND	--
4		CANH
5		CANL
6	GND	--
7	RS485A	--
8	RS485B	--



### Definition of RJ11 Port Pin


No.	RS 232 Pin
1	GND
2	TXD
3	RXD
4	GND



## Power Terminals

Power cable terminals: there are two pair of terminals with same function, one connect to equipment, the other one paralleling to other battery module for capacity expanding. For each single module, each terminal can achieve charging and discharging function.

For power cables uses water-proofed AMPHENOL connectors. It must keep pressing this Lock Button during pulling out the power plug.

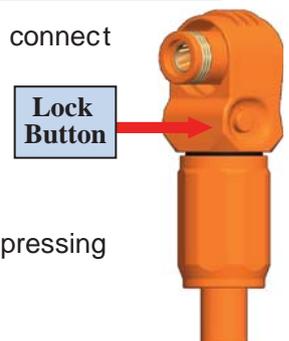



# Pylon Technologies Co., Ltd.

**PYLONTECH**

No. 73, Lane 887, Zu Chongzhi Road, Zhangjiang Hi-Tech Park  
Pudong, Shanghai 201203, China

## Dry Contact Terminal

Dry Contact Terminal: provided 1 way input and 3 ways output dry contact signal.

## LED Status Indicators

- ✧ RUN Lamp (No.6 Figure 2-1): green, long lighting when charging and flash when discharging;
- ✧ ALM Lamp (No.7 Figure 2-1 7): red, flashes when alarm and long bright if equipment failure or protected;
- ✧ Battery capacity indicator (No.8 Figure 2-1): 6 green lamps, each light represent 16.6% capacity.

## LED Indicators Instructions

Battery Statuses	Protection / Alarm / Normal	RUN	ALM	Capacity LED						Descriptions
		●	●	●	●	●	●	●	●	
Shut Down		Off	Off	Off	Off	Off	Off	Off	Off	All off
Standby	Normal	Flash1	Off	Off	Off	Off	Off	Off	Off	Indicates Standby
Charge	Normal	Light	Off	Based on capacity						The highest capacity indicator LED flashes (flash 2), others lighting
	Protection	Off	Light	Off	Off	Off	Off	Off	Off	Stop charging, ALM lighting
Discharge	Normal	Flash3	Off	Based on capacity						Indicate based on capacity
	Protection	Off	Light	Off	Off	Off	Off	Off	Off	Stop discharging, ALM lighting


**Note:** The flashing instructions, flash 1 - light 0.25s / off 3.75 seconds; flash 2 - 0.5s light / 0.5s off; flash 3 - 0.5s light / 1.5s off

**BMS function:**

Protection and Alarm	Management and Monitor
Charge/Discharge End	Cells Balance
Charge Over Voltage	Intelligent Charge Model
Charge/Discharge Over Current	Charge/Discharge Current Limit
High/Low Temperature	Capacity Retention Calculate
Short Circuit	Administrator Monitor
Power Cable Reverse	Operation Record

### 3. Safe handling of lithium batteries Guide

#### 3.1 Schematic Diagram of Solution

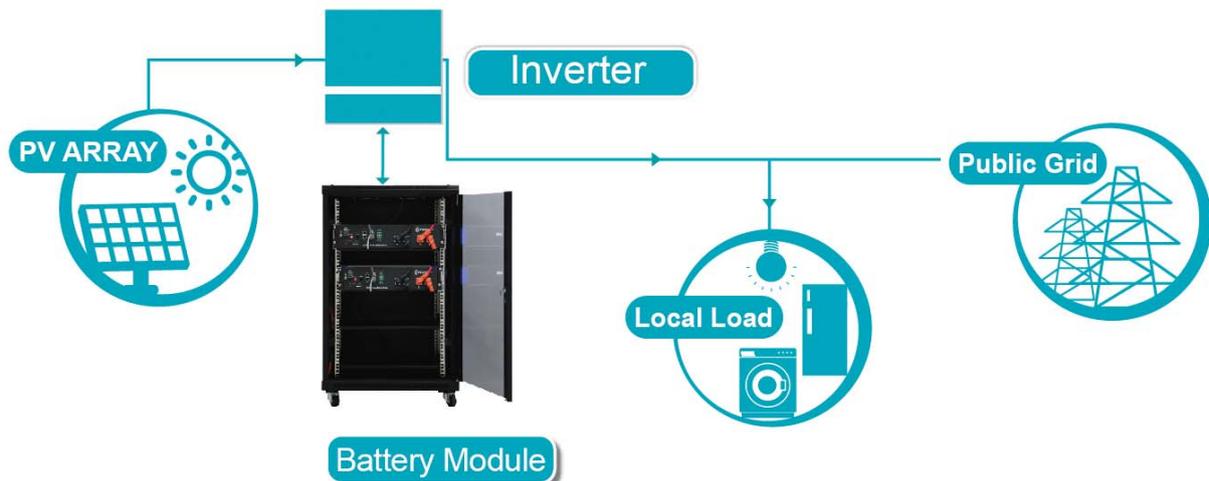

#### 3.2 Explanation of Symbol


DANGER
HIGH VOLTAGE INSIDE



Do not disconnect, disassemble or repair by yourself.  
Do not drop, deform, impact, cut or spearing with a sharp object.  
Do not place near open flame or incinerate.  
Do not sit or put heavy things on battery.  
Keep away from moisture or liquid.  
Keep out of reach of children, animals or insects.  
Contact the supplier within 24 hours if anything wrong.

Emergency Situations  
If leaking, fire, wet or damaged, switch off the breaker and get away from the battery. Do not touch the leaking liquid.

### 3.3 Tools

The following tools are required to install the battery pack



**Wire cutter**



**Crimping Modular Plier**



**Screw Driver**

#### NOTE

Use properly insulated tools to prevent accidental electric shock or short circuits.

If insulated tools are not available, cover the entire exposed metal surfaces of the available tools, except their tips, with electrical tape.

### 3.4 Safety Gear

It is recommended to wear the following safety gear when dealing with the battery pack



**Insulated gloves**



**Safety goggles**



**Safety shoes**

### 3.5 Accessories

The type and quantity of the accessories are subject to the battery packing list.




**RJ45 Communication Cable**



**+ / - Power Cable**

#### NOTE

Power cable uses water-proofed AMPHENOL connectors. It must keep pressing this Lock Button during pulling out the power plug.



**Lock Button**


## 4. Installation

### 4.1 Package Items


#### Unpacking and check the Packing List

##### 1) For battery module package:

Two power cables and one communication cable for each battery package:

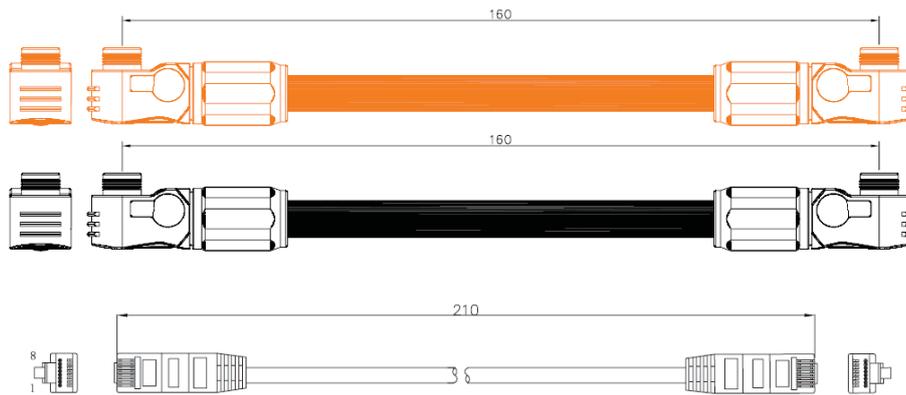


#### Grounding cable :



##### 2) For battery system connects to inverter:

Two long power cables (current capacity 120A) and one communication cable for each energy storage system:

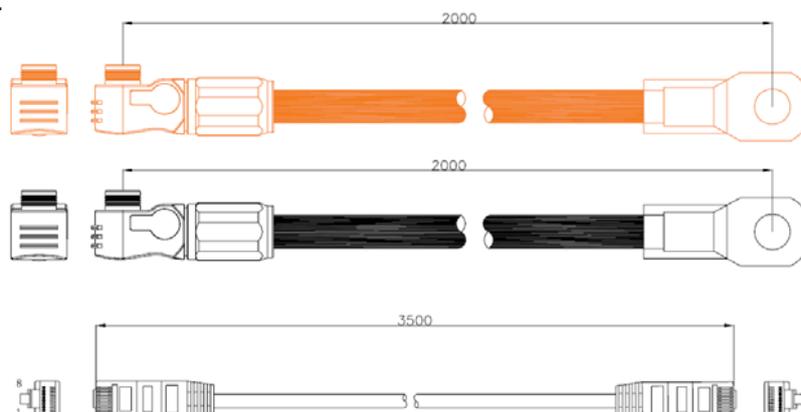

### NOTE

These three long cables are **NOT in battery package**, they are in another **extra small cable box**. If there is anything missed please contact dealer.

## 4.2 Installation Location

Make sure that the installation location meets the following conditions:

- ◆ The area is completely water proof.
- ◆ The floor is flat and level.
- ◆ There are no flammable or explosive materials.
- ◆ The ambient temperature is within the range from 0°C to 50°C.
- ◆ The temperature and humidity is maintained at a constant level.
- ◆ There is minimal dust and dirt in the area.

### CAUTION




If the ambient temperature is outside the operating range, the battery pack stops operating to protect itself. The optimal temperature range for the battery pack to operate is 0°C to 50°C.

Frequent exposure to harsh temperatures may deteriorate the performance and life of the battery pack.

### Installation

**Put battery modules into cabinet and connect the cables:**



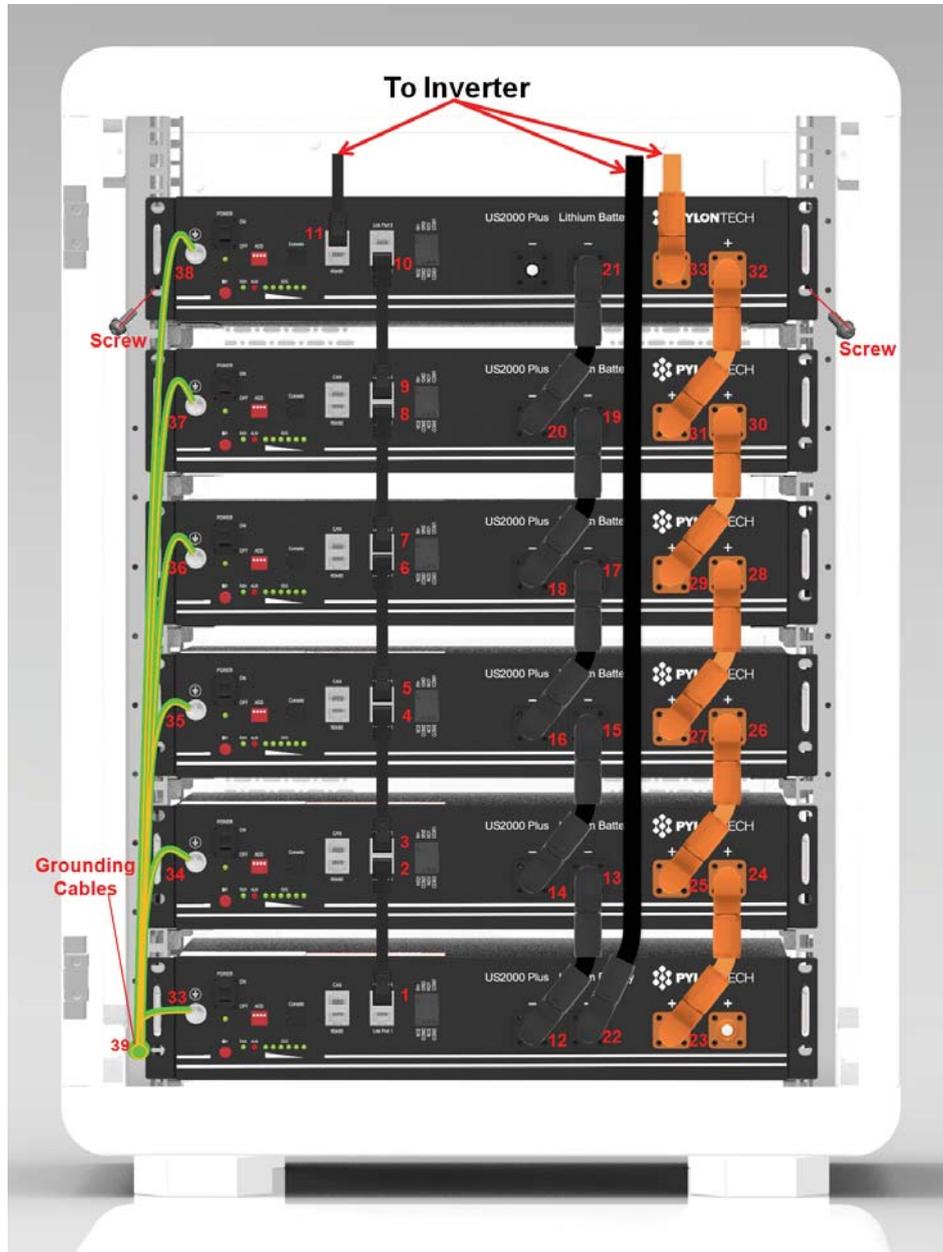


- ① Put the battery into the cabinet;
- ② Drive the 4 pcs screws;
- ③ Connect the cables between battery modules
- ④ Connect the cables to inverter

## B. Power On


Double check all the power cable and communication cable.

(1) Switch power on

Switch on all the battery modules and the green LED light below will be on:

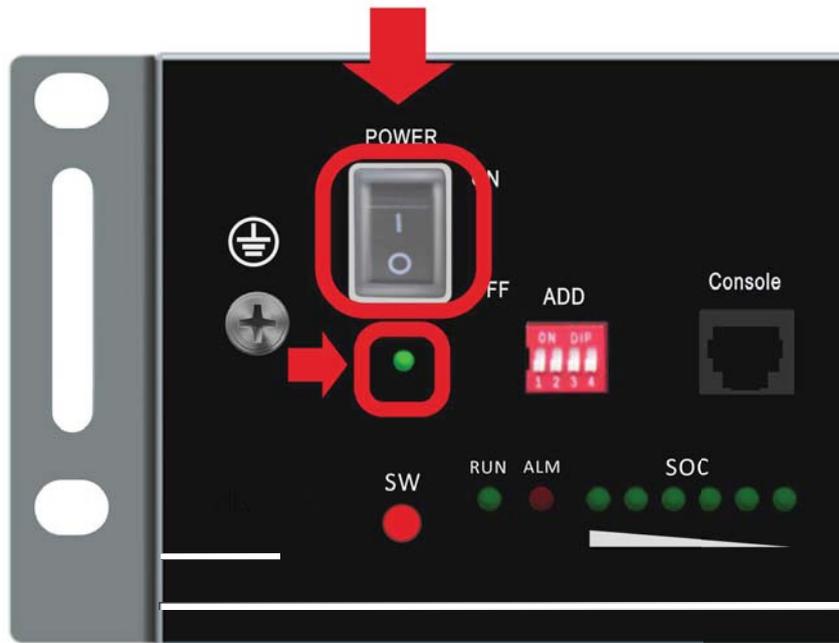

(2) The one with **empty Link Port 0** is the **Master Battery Module**, others are slaves:

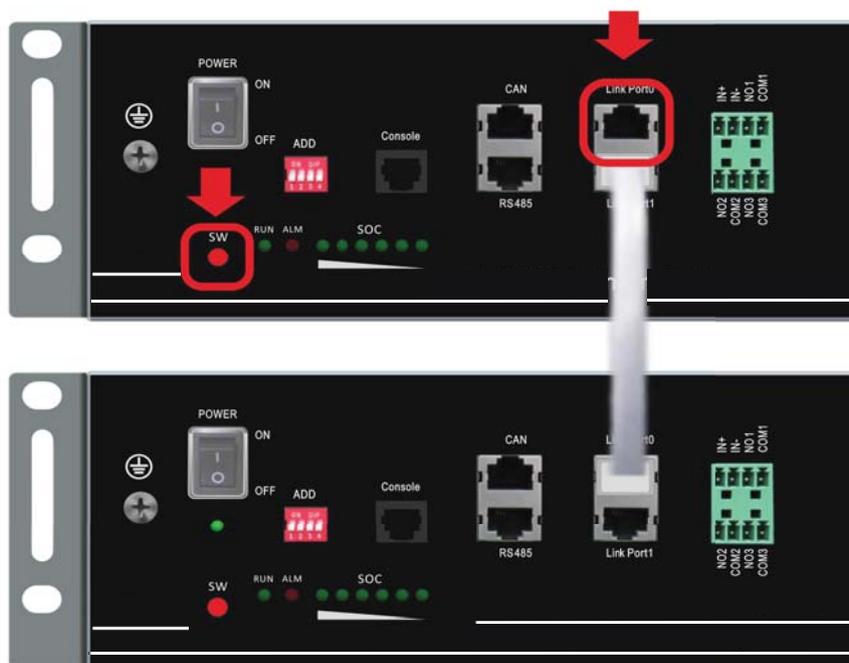



# Pylon Technologies Co., Ltd.

**PYLONTECH**

No. 73, Lane 887, Zu Chongzhi Road, Zhangjiang Hi-Tech Park  
Pudong, Shanghai 201203, China

(3) Press the **red button** of **master battery** to power on, all the battery LED light will be on one by one from the Master battery:



If all the battery LED lights on, and then off, which means the battery system is good and working.

### C. Installation with bracket:








1. Dismantle the 2 tabs on the battery.



2. Set the battery into 2 pcs **Bracket** from front and back.

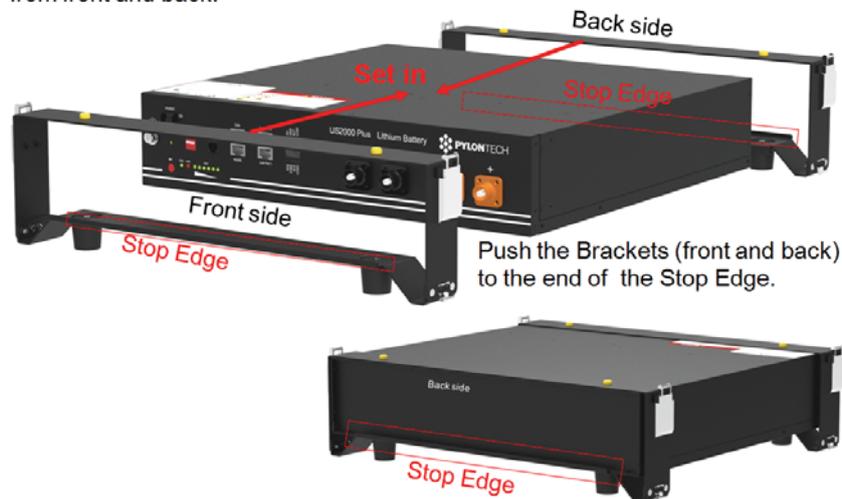

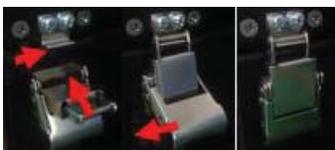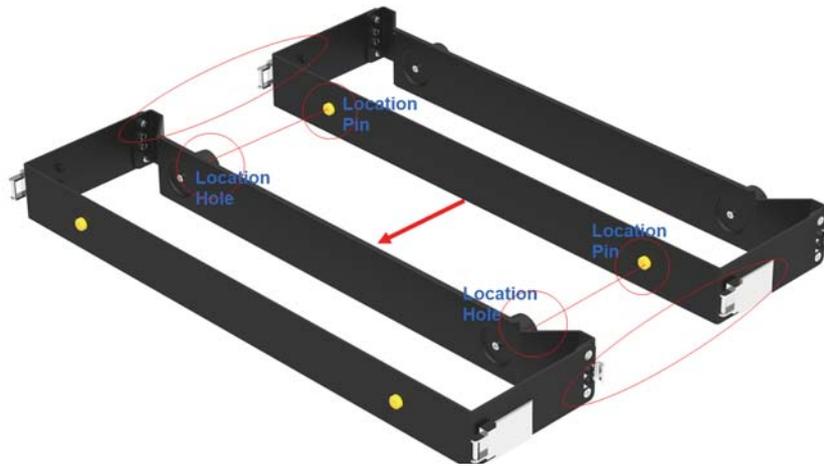

Aim at the 4 pare of Location Pin and Location Hole, stack the batteries together. And hasp the 4 agraffes together.

**Maximum 4 batteries can be athwart stacked:**



**One or two batteries can be sidelong stacked,**



Cables connection and batteries system start are same as cabinet installation.

## **NOTE**

**After installation, do not forget to register online for full warranty:**

<http://www.pylontech.com.cn/service/support>

---



## 5. Trouble Shooting Steps

### 5.1 Problem determination based on:

- 1) Whether the battery can be turned on.
- 2) If battery is turned on, check the red light is off, flashing or lighting;
- 3) If the red light is off, check whether the battery can be charged/discharged.

### 5.2 Preliminary determination steps:

- 1) *Battery cannot be turned on, switch on the lights are all no lighting or flashing.*

If the battery external switch is ON, the RUN light is flashing, and the external power supply voltage is 48V or more, the battery still unable to turn on, please contact distributor.

- 2) *The battery can be turned on, but red light is lighting, and cannot be charged or discharged, if the red light is lighting, that means system is abnormal, please check values as following:*

- a) Temperature: Above 50°C or under -10°C, the battery could not work.

Solution: to move battery to the normal operating temperature range between -10°C and 50°C

- b) Current: If current is larger than 100A, battery protection will turn on.

Solution: Check whether current is too large or not, if it is, to change the settings on power supply side.

- c) High Voltage: If charging voltage above 54V, battery protection will turn on.

Solution: Check whether voltage is too high or not, if it is, to change the settings on power supply side.

- d) Low Voltage: When the battery discharges to 44.5V or less, battery protection will turn on.

Solution: Charge the battery for some time, the red light will turn off.

Excluding the four points above, if the faulty is still cannot be located, turn off battery and repair.

## 5.3 The battery cannot be charged or discharged

### 1) Cannot be charged:

Disconnect the power cables, measure voltage on power side, if the voltage is 53~54V, restart the battery, connect the power cable and try again, if still not work, turn off battery and contact distributor.

### 2) Unable to discharge:

Disconnect the power cables and measure voltage on battery side, if it is under 44.5V, please charge the battery; if voltage is above 48V and still cannot discharge, turn off battery and contact distributor.

## 6. Emergency Situations

### 1) Leaking Batteries

If the battery pack leaks electrolyte, avoid contact with the leaking liquid or gas. If one is exposed to the leaked substance, immediately perform the actions described below.

Inhalation: Evacuate the contaminated area, and seek medical attention.

Contact with eyes: Rinse eyes with flowing water for 15 minutes, and seek medical attention.

Contact with skin: Wash the affected area thoroughly with soap and water, and seek medical attention.

Ingestion: Induce vomiting, and seek medical attention.

### 2) Fire

NO WATER! Only dry powder fire extinguisher can be used; if possible, move the battery pack to a safe area before it catches fire.

### 3) Wet Batteries

If the battery pack is wet or submerged in water, do not let people access it, and then contact distributor or an authorized dealer for technical support.

### 4) Damaged Batteries

Damaged batteries are dangerous and must be handled with the utmost care. They are not fit for use and may pose a danger to people or property. If the battery pack seems to be damaged, pack it in its original container, and then return it to distributor or an authorized dealer.

## NOTE

Damaged batteries may leak electrolyte or produce flammable gas. If such damage occurs, please contact Pylontech: [service@pylontech.com.cn](mailto:service@pylontech.com.cn)



**PYLONTECH**

**Pylon Technologies Co., Ltd.**

No. 73, Lane 887, ZuChongzhi Road, Zhangjiang Hi-Tech Park  
Pudong, Shanghai 201203, China

**T**+86-21-51317697 | **F** +86-21-51317698

**E**[service@pylontech.com.cn](mailto:service@pylontech.com.cn)

**W**[www.pylontech.com.cn](http://www.pylontech.com.cn)